


# Millennium Unit with Synthesis Controls

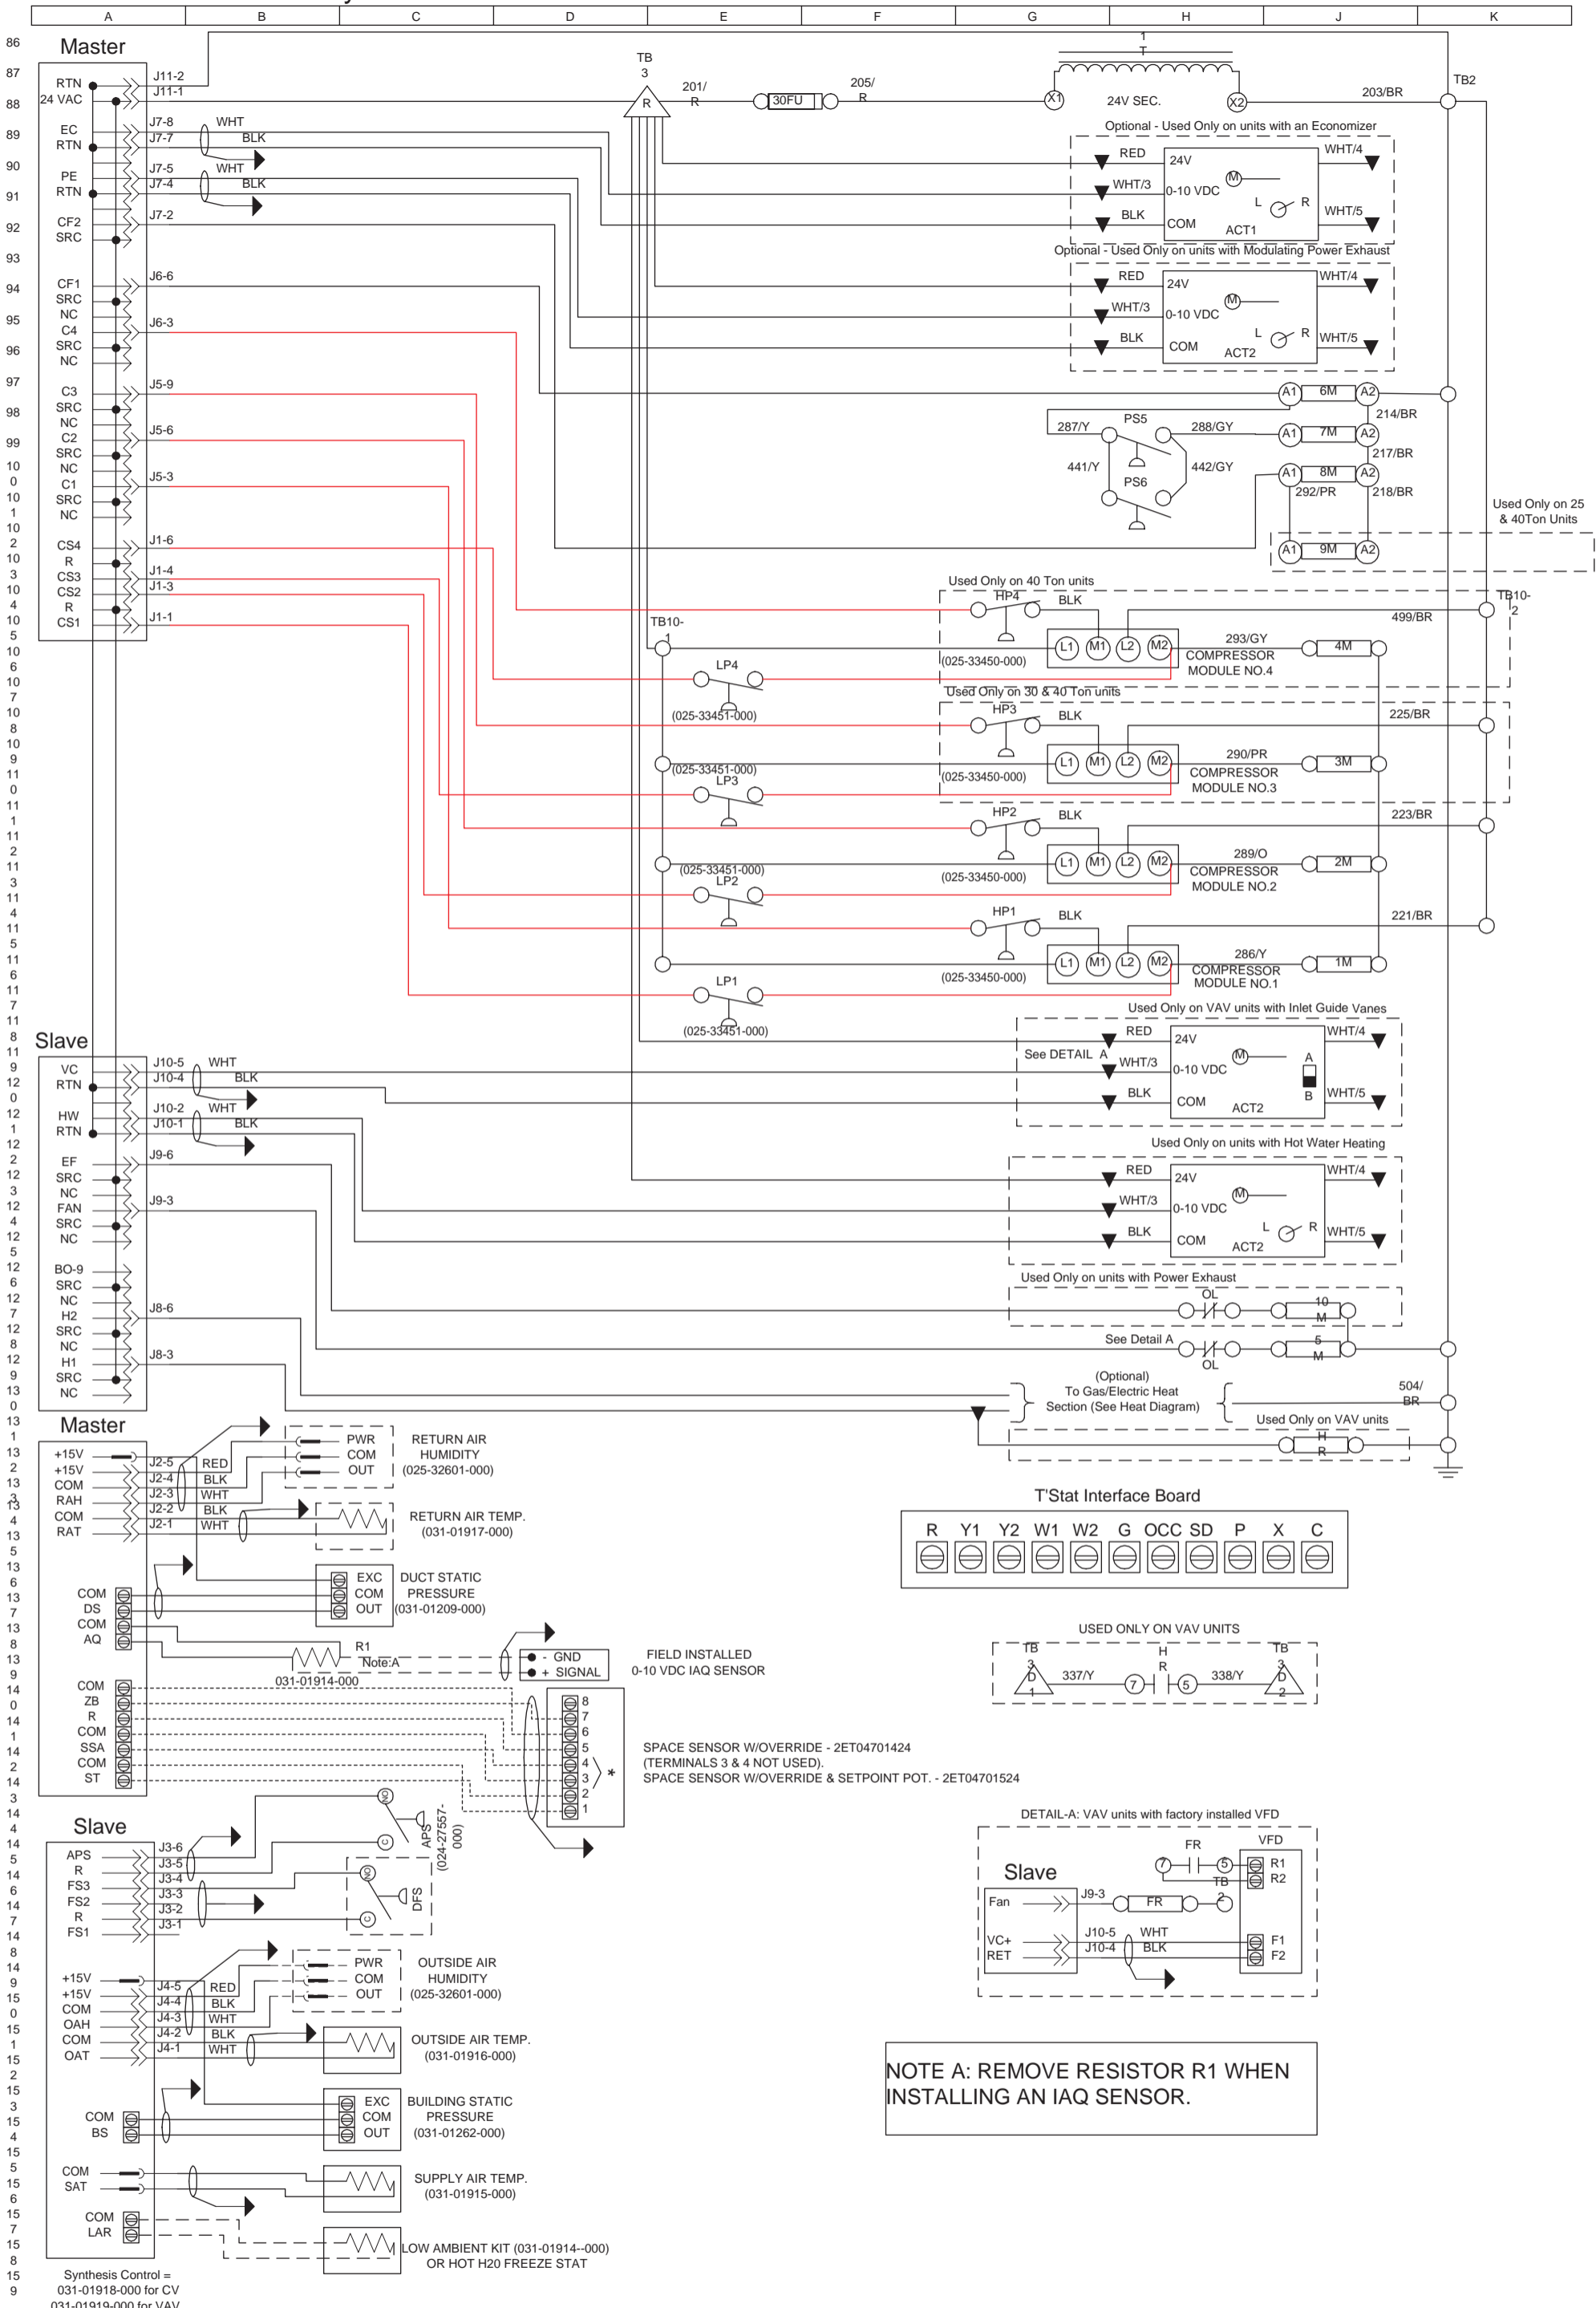

**NOTE A: REMOVE RESISTOR R1 WHEN INSTALLING AN IAQ SENSOR.**

Synthesis Control =  
031-01918-000 for CV  
031-01919-000 for VAV.