




Product Data

16JB Steam/Hot Water Single Effect, Hermetic Absorption Liquid Chiller 50/60 Hz

108 to 680 Nominal Tons (380 to 2392 kW)

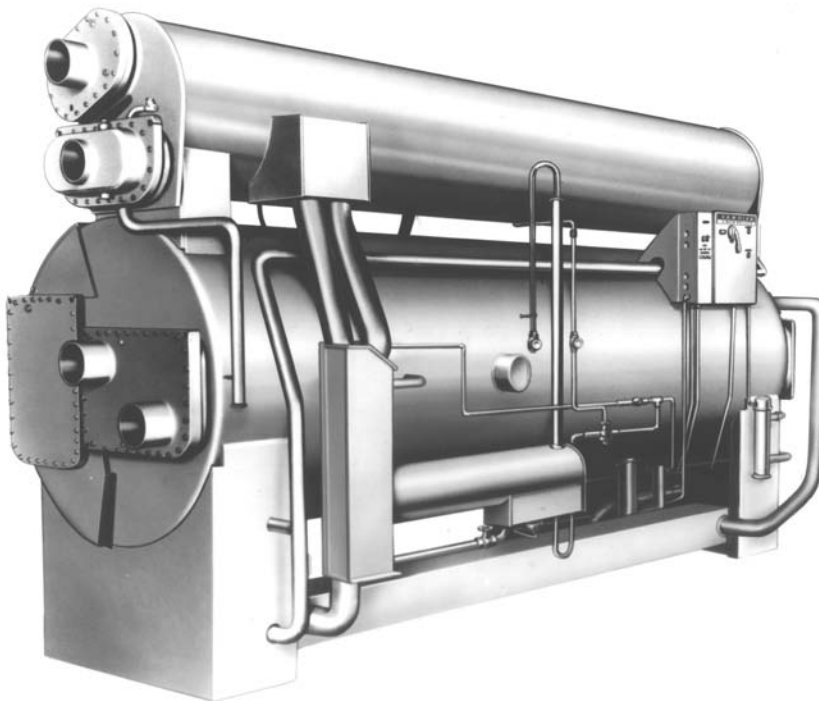

Carrier's 16JB single effect hermetic absorption liquid chiller offers a viable alternative to traditional electric driven chillers. By utilizing low pressure steam or hot water, the 16JB avoids high cost electricity and qualifies for utility rebates and incentives as a *gas cooling* product. The utilization of low pressure steam or hot water in the generator provides the 16JB with application flexibility.

- no CFCs; environmentally friendly
- one-stage design for simple, reliable operation
- operates using low pressure steam or hot water
- quiet, vibration-free operation
- few moving parts equates to high reliability

Features/Benefits

Single effect absorption provides efficient, economical water chilling with minimal use of electricity.

Cost-effective cooling

Alternative-energy chiller — The 16JB offers an alternative for building owners who want to avoid the high operating costs associated with electric-driven chillers. Powered by low pressure steam or hot water, the Carrier 16JB single effect absorption chiller not only reduces or eliminates electric demand and/or ratchet charges, but also allows the owner to take advantage of gas cooling rebates and incentive programs offered by many utility companies.

Single, reliable operation — The 16JB absorption chiller employs a single generator to provide one stage



of solution reconcentration, making it the most basic of the cycles available today. Simplicity of design, combined with its numerous other quality features, equates to inherently high reliability. Few moving parts and simple, dependable operation reduce downtime, as well as service and maintenance costs. The 16JB chiller offers typical full-load steam rates of approximately 18 lb/hr-ton at standard ARI (Air Conditioning and Refrigeration Institute) operating conditions.

Superior part-load performance — The 16JB's standard concentration control system allows stable, part-load operation at cooling water temperatures as low as 55 F (12.8 C) without the need for a cooling tower bypass. In addition, a control valve ensures stable, continuous evaporator pump operation at part-load conditions. The 16JB has a continuous operating range from 100% to 10% of machine capacity.

Application versatility
Designed to suit a variety of applications — The use of steam or hot water from a number of sources allows the 16JB machine to meet a variety of cooling needs. Waste heat sources generated from industrial processes and cogeneration systems can be utilized to provide chilled water for process cooling as well as comfort cooling, reducing the need for purchased energy and contributing to even greater energy savings.

Ideal for new or retrofit applications — Whether intended for replacement of existing chiller systems or for new construction purposes, the 16JB is well suited to meet the needs of almost any cooling application. The 16JB's 15 model sizes, spanning a capacity range of 108 to 680 tons, make the 16JB single effect absorption chiller the ideal choice for comfort cooling and/or light industrial applications. Carrier's computerized performance ratings assist in the selection of the appropriate machine, properly sized to meet exact job requirements. Dependable operation, as well as low sound and vibration levels, ensures occupant comfort, even when installed on upper floors.

Combine absorption and electric-driven chillers — Utilizing both absorption and electric chillers in

a central plant offers the flexibility to base load one chiller, while using the other to handle peak load requirements. Hybrid chiller systems have proven to be an economical solution for many comfort cooling installations. In many geographical areas, operating the electric chiller as the base loaded machine, while utilizing the absorption chiller during peak load conditions, avoids or reduces electric demand charges. Depending on utility rate structures, a 16JB single effect absorption chiller used in conjunction with an electric-driven chiller may be the most efficient and cost-effective combination available.

Location and installation savings
Ease of installation — All 16JB's are completely fabricated, assembled, and wired in the factory as single piece units. Standard shipping configuration is either 1- or 2-piece(s),

depending on size. Refer to the 16JB Standard Shipping Configuration table below.

16JB STANDARD SHIPPING CONFIGURATION


SIZE	1-PIECE	2-PIECES
010-047	X	
054-068		X

Model sizes through 16JB047 ship completely assembled as standard with an option for 2-piece shipment. The 2-piece shipment is ideal for retrofit or replacement installations where access into the equipment room may be limited. The 16JB054-068 machines ship in 2 pieces as standard for easier handling and rigging. Job-site re-assembly and alignment of units shipped in 2 sections is simplified by pre-erecting the machine in the factory and incorporating weld-type assembly flanges on all interconnecting piping.

Table of contents

	Page
Features/Benefits	1-7
Model Number Nomenclature	2
Options and Accessories	8
Machine Components	9
Physical Data	10, 11
Dimensions	12
Performance Data	13
Application Data	14, 15
Electrical Data	16, 17
Typical Piping and Wiring	18
Guide Specifications	19-22

Model number nomenclature

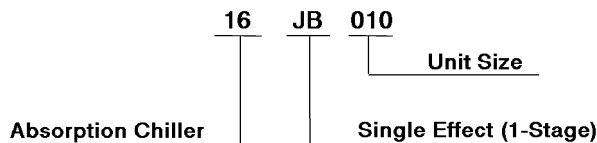

Features/Benefits (cont)



Single point electrical connection

— Installation costs are further reduced by eliminating field wiring between machine components. All unit-mounted electrical items are factory-wired to the chiller control center and require only a single point electrical connection to the machine from the building's electrical service. A multi-tap transformer mounted in the chiller panel provides secondary single-phase power for the 16JB controls.

Low sound and vibration levels allow location flexibility

— Low sound and vibration levels are characteristic of absorption chillers, primarily due to the fact that the only rotating parts are the refrigerant and solution pumps. The overall sound level of a Carrier 16JB is typically 80 dbA. This allows the machine to be installed near occupied spaces or in areas with strict sound requirements. Low vibration levels also make it possible to install the chiller on upper flows without special consideration for vibration dampening systems.

Low maintenance

Standard features simplify maintenance procedures

— Every 16JB is provided with numerous standard design features that provide for convenient and simple maintenance. Removable waterbox covers on the evaporator, absorber, and condenser facilitate tube and waterbox inspection from either end. All moving parts are easily accessible for inspection or replacement, as required. The U-bend tube design in the generator greatly reduces the likelihood of expensive and time-consuming tube bundle replacement. Unlike ordinary tubes, the U-bend configuration allows the entire tube bundle to expand or contract as a unit when subjected to rapid temperature changes. The tube bundle floats and adjusts freely as a unit, decreasing tube wear due to thermal stresses and reducing tube bundle failures. Each shell is divided by a "U-baffle" forming a double sump. The U-baffle design not only forms a thermal barrier between the sections but also allows the solution or refrigerant to be stored temporarily on one side of the vessel while the other side is being serviced, consequently reducing maintenance costs.


Factory-trained service organization

— Carrier's extensive service organization offers trained and experienced service technicians in every major city. In addition to routine maintenance and repair services, Carrier also offers a wide array of preventative maintenance, full maintenance, and/or extended service contracts which can be custom-tailored to fulfill any service requirements.

Leakproof hermetic pumps cut maintenance costs

— Carrier's proven solution and refrigerant pump/motors are leakproof, completely self-contained, and hermetically sealed. The hermetic design eliminates the need for a separate, complicated, and possibly leakprone seal water system and auxiliary water piping, while providing leak tightness and longer machine life. There are no packing glands or seals to maintain — air cannot leak in, fluids cannot leak

out. Specially designed bearings absorb both radial and axial thrusts to ensure correct fit at all times. There is no possibility of external contamination since the fluid being pumped lubricates and cools the pump and motor assemblies. In addition, both the rotor and stator are separated by a stainless steel liner that protects the windings from the fluid being pumped. As an additional safety feature, thermal overload switches are embedded in the stator to protect against high winding temperature. The pumps are field serviceable and inspection is recommended after 6 years of operation. Pump isolation valves are not included on 16JB machines to minimize potential leak paths into the machine. The pump isolation valves are not required because of the exceptionally high reliability of the pump/motor assemblies.

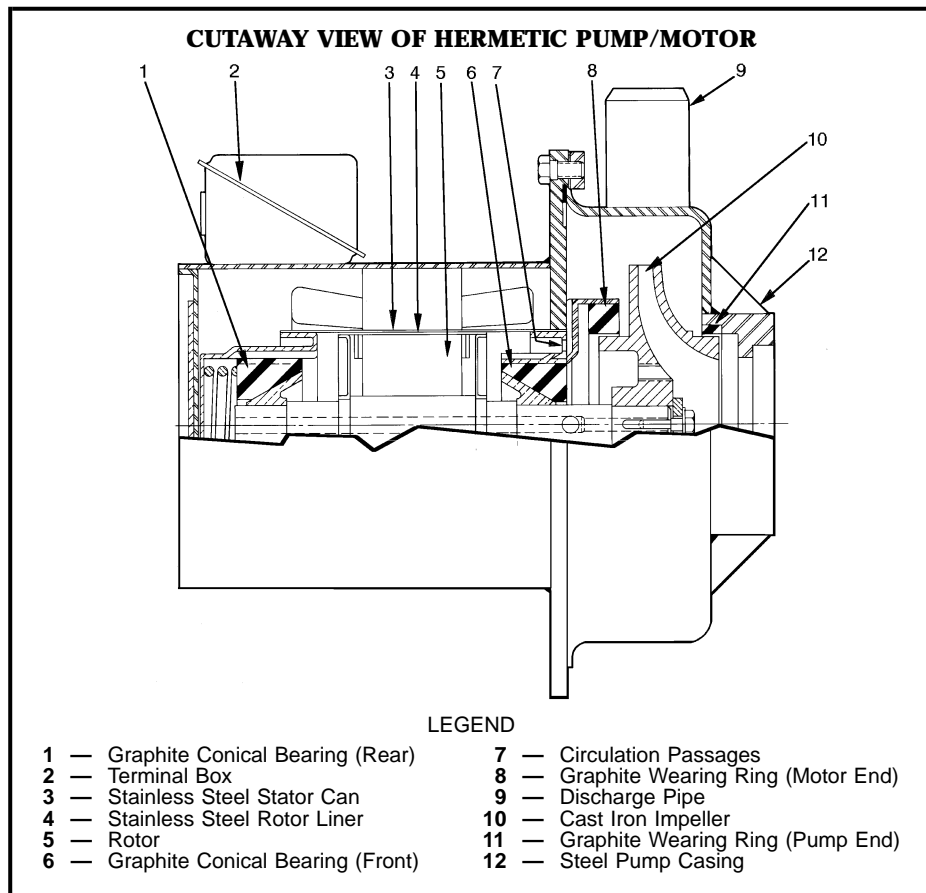

Features/Benefits (cont)



Reliable operation

16JB control system features automatic monitoring and precise control of machine operation —

Each Carrier 16JB single effect chiller includes a factory mounted and wired control center which is functionally tested prior to shipment. Continuous monitoring and control of machine operation is performed automatically. Chiller operational status is displayed on the front of the panel. Control center components include an electronic (or optional pneumatic) capacity control module, fused disconnect switch, pump contactors, ambient-compensated 3-phase pump overloads,



multi-tap control power transformer, elapsed time indicator, terminal blocks, relays, auto/manual concentration control switch, refrigerant and solution pump operational switch, exhaust purge light, and all other necessary safeties and controls for proper machine operation.

Superior corrosion protection — Absorption chillers must be protected from the internal corrosion that is always present when lithium bromide solution is in contact with internal machine surfaces. The Carrier 16JB absorption chiller incorporates a highly effective corrosion inhibitor to provide an extra margin of protec-

tion against internal corrosion. Other inhibitors may necessitate the use of exotic tube materials in certain heat exchangers since they are less effective and require frequent maintenance and analysis. The superior corrosion protection of the inhibitor allows for the use of standard copper tubes throughout the machine (except for the generator [90/10 cupro-nickel]). This results in long machine life and dependable operation.

Rugged machine construction — Every Carrier 16JB offers numerous standard features designed to provide reliable, trouble-free operation. The machine is fabricated to

VIEW OF TYPICAL 16JB CONTROL CENTER

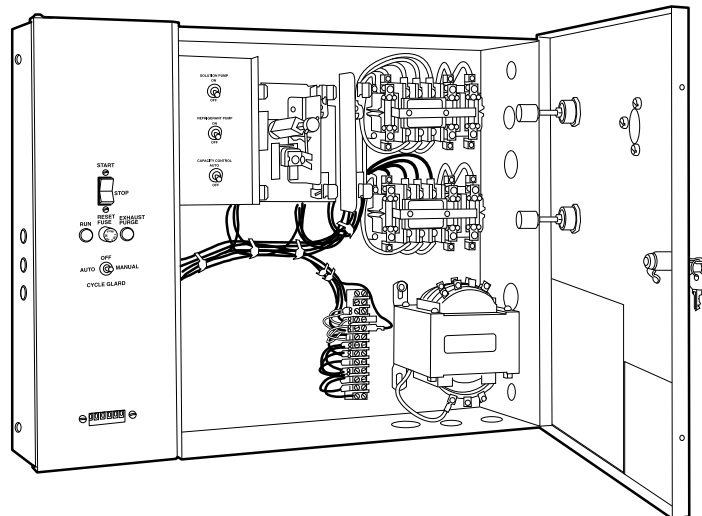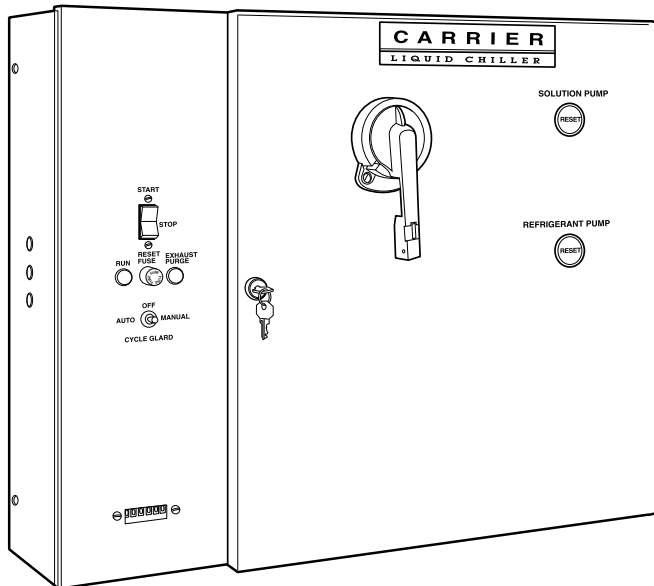

meet stringent manufacturing and design requirements. Non-clogging, corrosion-proof spray nozzles ensure against both corrosion and possible blockage for continuous, reliable operation. U-bend tubes of 90/10 cupro-nickel in the generator allow the tube bundle to expand and adjust freely when subjected to rapid temperature changes. Allowing for this thermal growth and expansion reduces tube wear and helps prevent premature tube failure. The numerous standard features mean that every 16JB single effect chiller is built to withstand the most rigorous duty, whether it is used for comfort cooling or light process applications.

Automatic motorless purge extends machine life, ensures optimum efficiency and performance

— The purge system on an absorption chiller is critical to ensuring long machine life and efficient operation. All absorption chillers operate in a vacuum and generate hydrogen (and other noncondensable gases) in


small quantities, whether they are vacuum tight or properly inhibited. These gases are present in sufficient volume to interfere with proper machine operation, making it imperative that they be removed to protect against internal corrosion, lithium bromide solution crystallization, and/or reduction of chiller capacity. The Carrier motorless purge system protects against these potential hazards by operating *continuously* during machine operation.

How the motorless purge operates — During operation, any noncondensables which are present tend to accumulate in the absorber section which operates at the lowest internal pressure. A slip-stream of lithium bromide solution from the discharge of the solution pump flows through an eductor, creating a suction which draws the noncondensables from the absorber, entraining them with the solution flowing through the eductor. The two eductors discharge the solution and noncondensables into a

storage tank, where some of the noncondensables are separated from the solution. The solution and remaining noncondensables flow to a separator where the remaining noncondensables are separated and flow back to the storage chamber, while the solution returns to the absorber sump through the generator overflow pipe.

As noncondensables accumulate in the external storage chamber, they are isolated from the chiller and cannot re-enter the machine, even during shutdown. These gases must periodically be exhausted (normally once or twice a year) from the storage chamber by a simple procedure which can be performed while the machine is running. Evacuation is accomplished by manually positioning valves to pressurize the storage chamber with lithium bromide solution and then exhausting the noncondensable gases into the atmosphere.

16JB MOTORLESS PURGE SYSTEM

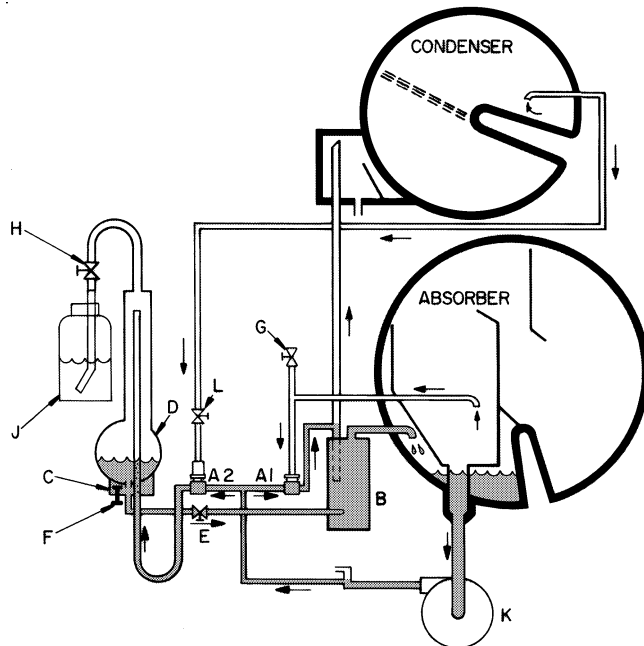

LEGEND

- | | |
|--------------------------------|--------------------------------|
| A1 — Absorber Transfer Device | F — Level Indicator |
| A2 — Condenser Transfer Device | G — Auxiliary Evacuation Valve |
| B — Secondary Heater Exchanger | H — Exhaust Valve |
| C — Separation Pot | J — Exhaust Bottle |
| D — Storage Chamber | K — Hermetic Solution Pump |
| E — Solution Return Valve | L — Purge Valve |

Features/Benefits (cont)



Carrier Cycle-Guard™ anti-crystallization controls maintain proper solution concentration


— The 16JB automatically limits solution concentration in several ways to avoid both crystallization and overdilution to provide dependable, trouble-free operation. Crystallization of the lithium bromide solution depends on the combination of temperature and concentration. Carrier's Cycle-Guard concentration control system automatically monitors the refrigerant water level in the evaporator in conjunction with the solution temperature returning to the absorber. Because concentration varies with the amount of water in the lithium bromide solution, a rising evaporator level indicates less water in the solution and thus a higher solution concentration. When the refrigerant in the evaporator rises to a preset level,

water is transferred from the evaporator to the absorber, thus preventing overconcentration to ensure continuous, reliable operation even at cooling water temperatures as low as 55 F (12.8 C).

The 16JB also incorporates a simple, passive method of control to correct any crystallization that would normally start to occur on the shellside of the low temperature solution heat exchanger under abnormal conditions. As the hot solution begins to back up in the generator as a result of any shellside blockage, it rises above the overflow pipe and returns directly to the absorber. It is subsequently pumped through the tubeside (heating the shellside) to restore proper operation.

In addition, the 16JB automatic dilution cycle ensures proper concen-


tration after a scheduled unit shutdown so that the unit will not crystallize when the machine cools to ambient or machine room temperature. The dilution cycle controls operation of the pumps until the refrigerant drops to a predetermined level and the dilution level switch opens. The opening of the dilution level switch deenergizes the pumps after shutdown. This dilutes the solution to prevent an overconcentration condition. Crystallization is also minimized by the gravity drain feature of the generator on the 16JB. The force of gravity and top-mounting of the generator above the absorber enable the strong solution to drain out of the generator should a power outage occur.

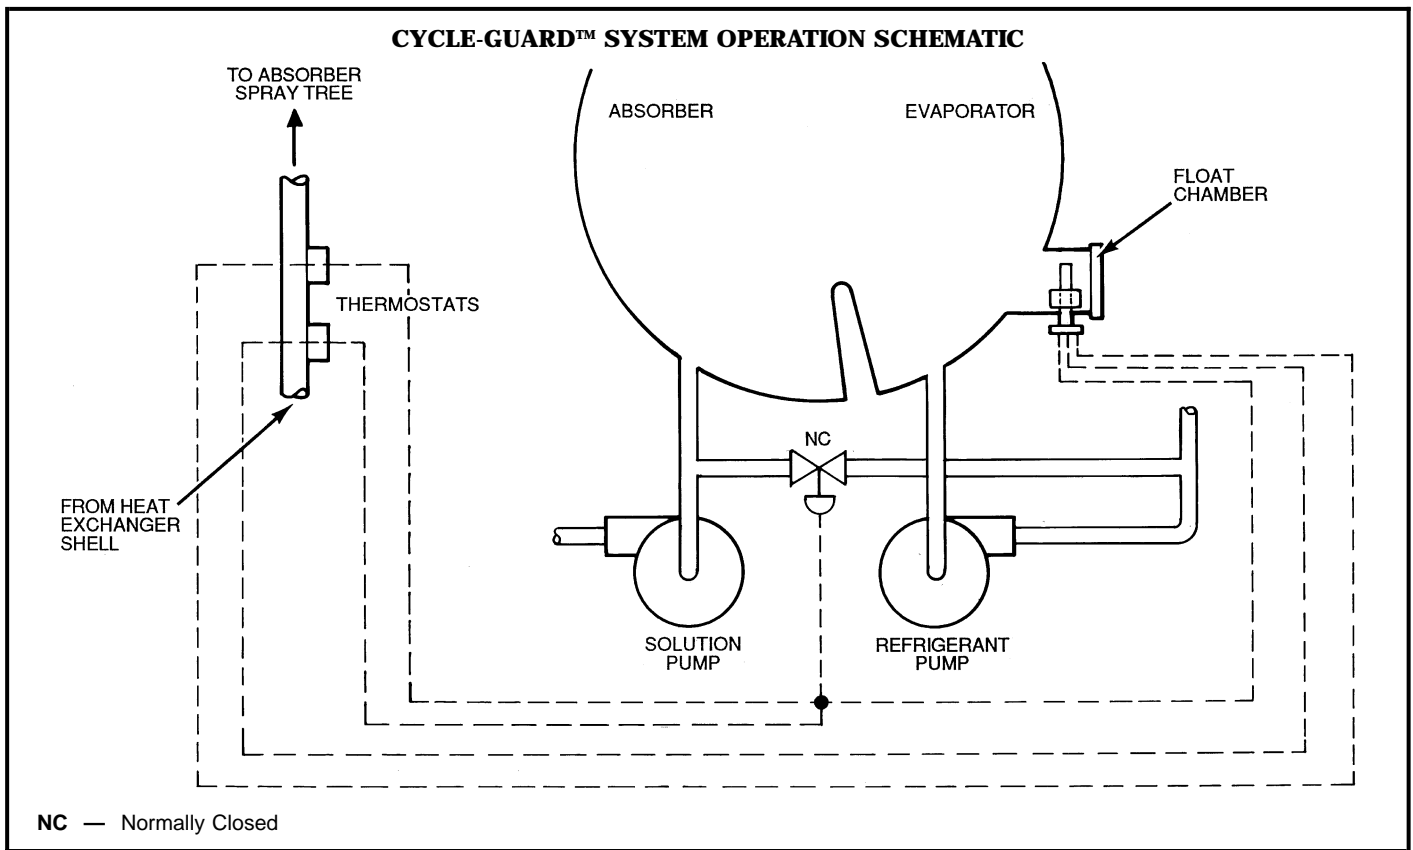

16JB single effect absorption cooling cycle — The 16JB single effect absorption chiller consists of an evaporator, absorber, condenser, steam or hot water generator, solution heat exchanger, refrigerant/solution pumps, purge, controls, and auxiliaries. Water is used as the refrigerant in vessels maintained under low absolute pressure (vacuum). The chiller operates on the principle that under vacuum, water boils at a low temperature (in this case approximately 40 F [4.4 C]), thereby cooling the chilled water circulating through the tubes of the evaporator. A refrigerant pump is used to circulate the refrigerant water over the evaporator tubes to improve heat transfer.

To make the cooling process continuous, the refrigerant vapor must be removed as it is produced. A lithium bromide solution (which has a high affinity for water) is used to absorb the water vapor. As this process continues, the lithium bromide becomes diluted, which reduces its absorption capacity. A solution pump then transfers this weak (diluted) solution to the generator where it is reconcentrated by the introduction of steam or hot water to boil off the previously absorbed water. The water vapor released in the shellside of the generator then enters the condenser to be cooled and returned to a liquid state. At this point, the refrigerant water returns to the evaporator to begin a new cycle.

To remove heat from the machine, relatively cool water from a cooling tower or other source is first circulated through the tubes of the absorber to remove the heat of vaporization. This same water is then circulated through the tubes of the condenser. The strong (reconcentrated) solution from the generator flows back to the absorber to also begin a new cycle. For efficiency reasons, the strong solution from the generator is passed through a solution heat exchanger to preheat the weak solution while precooling the strong solution before returning to the absorber.

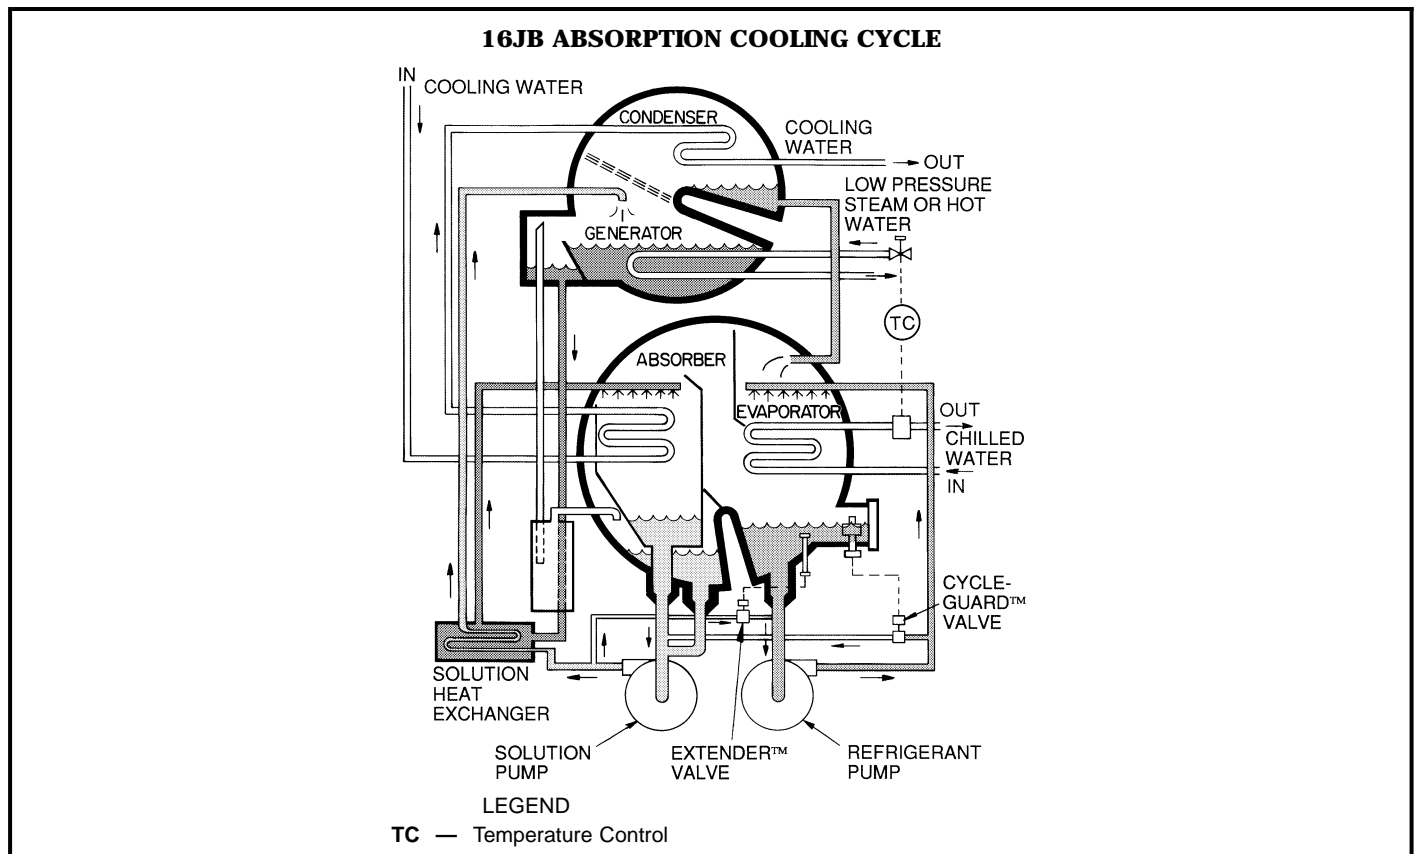

Options and accessories




ITEM	OPTION*	ACCESSORY†
150 psig (1034 kPa)/250 psig (1724 kPa) Marine Waterboxes	X	
250 psig (1724 kPa) NIH Waterboxes	X	
Special Tubing	X	
Absorber-Condenser Crossover Piping	X	X
Unit Voltage	X	
Steam Demand Limiter	X	
CSA Certification	X	
Flanged Waterbox Connections	X	
Victaulic Waterbox Connections	X	
Shipping Configuration (1- or 2-piece)	X	
Hot Water Generator (ASME 250 psig [1724 kPa])	X	
Steam Valve (Electric or Pneumatic)		X
Thermometer Set		X
Isolation Package		X
Chilled/Condenser Water Flow Switches		X

LEGEND

CSA — Canadian Standards Association
NIH — Nozzle-in-Head

*Factory installed.
 †Field installed.

Machine components

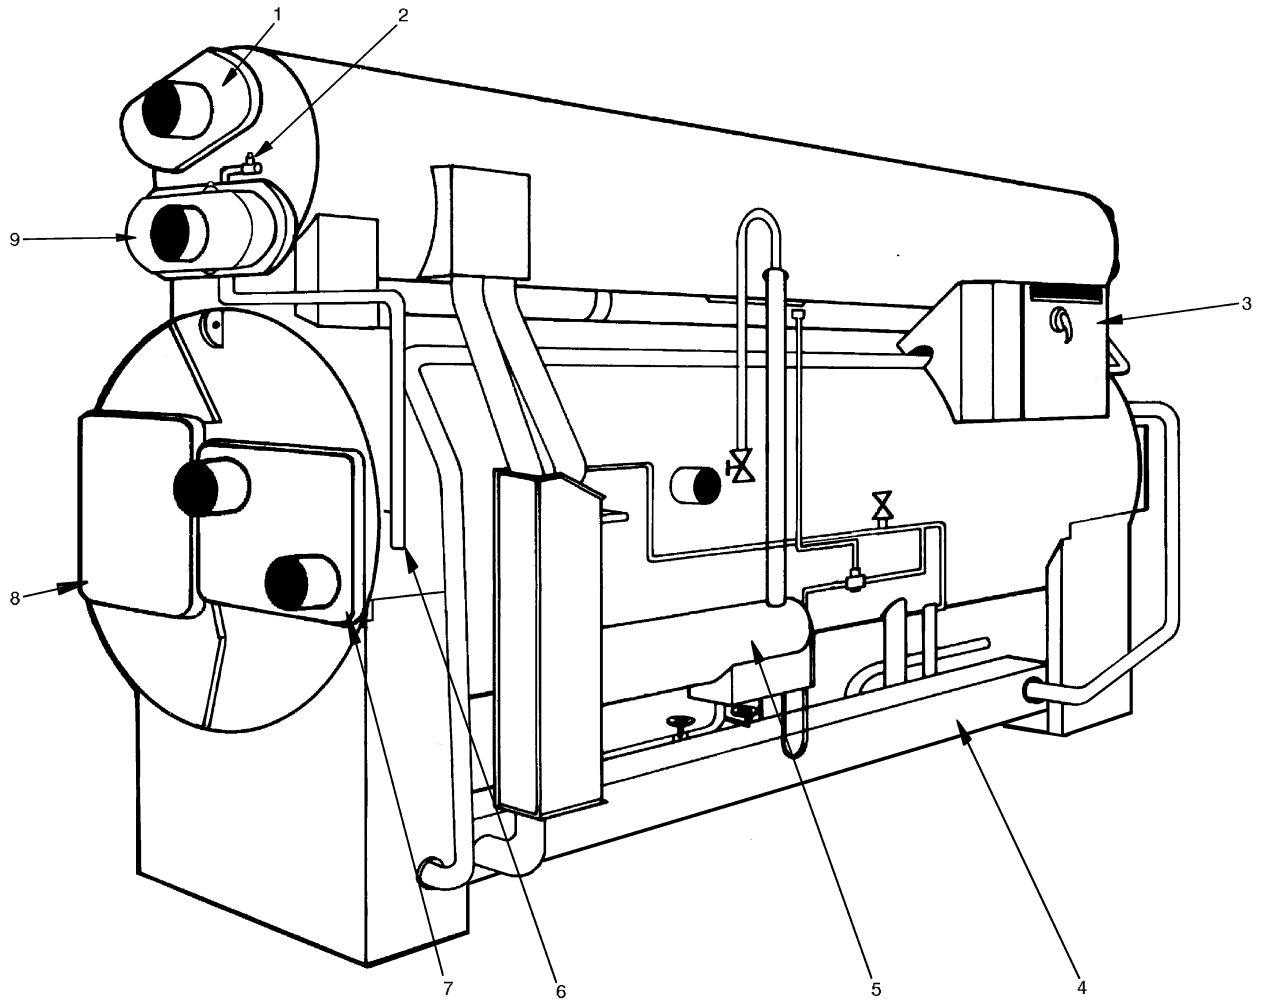

LEGEND

- 1 — Condenser
- 2 — Steam Box Vacuum Breaker
- 3 — Control Center
- 4 — Solution Heat Exchanger
- 5 — Purge Storage Chamber
- 6 — Condensate Drain Line
- 7 — Absorber
- 8 — Evaporator
- 9 — Steam Generator

Physical data



ENGLISH

UNIT 16JB	010	012	014	018	021
NOMINAL COOLING CAPACITY (ton)	108	122	137	186	211
RIGGING WEIGHT* (lb)					
Absorber/Evaporator	6,300	6,370	6,370	8,050	8,610
Generator/Condenser	2,700	2,730	2,730	3,450	3,690
Total	9,000	9,100	9,100	11,500	12,300
OPERATING WEIGHT (lb)	11,240	11,400	11,480	14,860	15,750
LITHIUM BROMIDE SOLUTION CHARGE (gal)	110	110	110	160	160
REFRIGERANT (WATER) CHARGE (gal)	40	40	40	50	50
CHILLED WATER					
Pipe Connection Size (in.)	4	4	4	6	6
No. of Passes	2	2	2	2	2
COOLING WATER					
Pipe Connection Size (in.)	6	6	6	6	6
No. of Passes					
Absorber	2	2	2	2	2
Condenser	1	1	1	1	1
STEAM/HOT WATER					
Pipe Connection Size (in.)					
Steam Inlet/Hot Water Inlet	3/2.5	3/2.5	3/2.5	4/3	4/3
Condensate Outlet/Hot Water Outlet	1.25/2.5	1.25/2.5	1.25/2.5	1.25/3	1.25/3

UNIT 16JB	024	028	032	036	041
NOMINAL COOLING CAPACITY (ton)	245	279	326	362	413
RIGGING WEIGHT* (lb)					
Absorber/Evaporator	10,220	10,370	12,950	13,230	18,000
Generator/Condenser	4,380	4,440	5,550	5,670	5,550
Total	14,600	14,810	18,500	18,900	23,550
OPERATING WEIGHT (lb)	18,860	19,410	23,890	24,430	30,070
LITHIUM BROMIDE SOLUTION CHARGE (gal)	200	200	240	240	300
REFRIGERANT (WATER) CHARGE (gal)	65	65	70	70	90
CHILLED WATER					
Pipe Connection Size (in.)	6	6	8	8	8
No. of Passes	2	2	2	2	2
COOLING WATER					
Pipe Connection Size (in.)	8	8	8	8	10
No. of Passes					
Absorber	2	2	2	2	2
Condenser	1	1	1	1	1
STEAM/HOT WATER					
Pipe Connection Size (in.)					
Steam Inlet/Hot Water Inlet	6/4	6/4	6/4	6/4	6/6
Condensate Outlet/Hot Water Outlet	1.5/4	1.5/4	2/4	2/4	2/6

UNIT 16JB	047	054	057	061	068
NOMINAL COOLING CAPACITY (ton)	479	539	574	618	680
RIGGING WEIGHT* (lb)					
Absorber/Evaporator	18,500	21,500	22,000	26,500	28,000
Generator/Condenser	5,550	7,000	7,000	7,000	7,400
Total	24,050	28,500	29,000	33,500	35,400
OPERATING WEIGHT (lb)	30,850	36,900	37,740	43,480	45,890
LITHIUM BROMIDE SOLUTION CHARGE (gal)	300	300	300	360	360
REFRIGERANT (WATER) CHARGE (gal)	90	175	175	265	265
CHILLED WATER					
Pipe Connection Size (in.)	8	8	8	8	8
No. of Passes	2	2	2	2	2
COOLING WATER					
Pipe Connection Size (in.)	10	10	10	10	10
No. of Passes					
Absorber	2	2	2	2	2
Condenser	1	1	1	1	1
STEAM/HOT WATER					
Pipe Connection Size (in.)					
Steam Inlet/Hot Water Inlet	6/6	8/6	8/6	8/6	8/6
Condensate Outlet/Hot Water Outlet	2/6	3/6	3/6	3/6	3/6

*Standard shipping configuration is 1-piece for sizes 010-047; 2-pieces for sizes 054-068.



SI

UNIT 16JB	010	012	014	018	021
NOMINAL COOLING CAPACITY (kW)	380	429	482	654	742
RIGGING WEIGHT* (kg)					
Absorber/Evaporator	2,860	2,900	2,900	3,660	3,910
Generator/Condenser	1,230	1,240	1,240	1,570	1,680
Total	4,090	4,140	4,140	5,230	5,590
OPERATING WEIGHT (kg)	5,110	5,180	5,220	6,750	7,160
LITHIUM BROMIDE SOLUTION CHARGE (kg)	665	665	665	970	970
REFRIGERANT (WATER) CHARGE (kg)	150	150	150	190	190
CHILLED WATER					
Pipe Connection Size (in.)	4	4	4	6	6
No. of Passes	2	2	2	2	2
COOLING WATER					
Pipe Connection Size (in.)	6	6	6	6	6
No. of Passes					
Absorber	2	2	2	2	2
Condenser	1	1	1	1	1
STEAM/HOT WATER					
Pipe Connection Size (in.)					
Steam Inlet/Hot Water Inlet	3/2.5	3/2.5	3/2.5	4/3	4/3
Condensate Outlet/Hot Water Outlet	1.25/2.5	1.25/2.5	1.25/2.5	1.25/3	1.25/3


UNIT 16JB	024	028	032	036	041
NOMINAL COOLING CAPACITY (kW)	862	981	1,147	1,273	1,453
RIGGING WEIGHT* (kg)					
Absorber/Evaporator	4,650	4,710	5,890	6,010	8,180
Generator/Condenser	1,990	2,020	2,520	2,580	2,520
Total	6,640	6,730	8,410	8,590	1,070
OPERATING WEIGHT (kg)	8,570	8,820	10,860	11,100	13,670
LITHIUM BROMIDE SOLUTION CHARGE (kg)	1,210	1,210	1,455	1,455	1,820
REFRIGERANT (WATER) CHARGE (kg)	250	250	265	265	340
CHILLED WATER					
Pipe Connection Size (in.)	6	6	8	8	8
No. of Passes	2	2	2	2	2
COOLING WATER					
Pipe Connection Size (in.)	8	8	8	8	10
No. of Passes					
Absorber	2	2	2	2	2
Condenser	1	1	1	1	1
STEAM/HOT WATER					
Pipe Connection Size (in.)					
Steam Inlet/Hot Water Inlet	6/4	6/4	6/4	6/4	6/6
Condensate Outlet/Hot Water Outlet	1.5/4	1.5/4	2/4	2/4	2/6

UNIT 16JB	047	054	057	061	068
NOMINAL COOLING CAPACITY (kW)	1,685	1,896	2,019	2,173	2,392
RIGGING WEIGHT* (kg)					
Absorber/Evaporator	8,410	9,770	10,000	12,050	12,730
Generator/Condenser	2,520	3,180	3,180	3,180	3,360
Total	10,930	12,950	13,180	15,230	16,090
OPERATING WEIGHT (kg)	14,020	16,770	17,150	19,760	20,860
LITHIUM BROMIDE SOLUTION CHARGE (kg)	1,820	1,820	1,820	2,180	2,180
REFRIGERANT (WATER) CHARGE (kg)	340	660	660	1,000	1,000
CHILLED WATER					
Pipe Connection Size (in.)	8	8	8	8	8
No. of Passes	2	2	2	2	2
COOLING WATER					
Pipe Connection Size (in.)	10	10	10	10	10
No. of Passes					
Absorber	2	2	2	2	2
Condenser	1	1	1	1	1
STEAM/HOT WATER					
Pipe Connection Size (in.)					
Steam Inlet/Hot Water Inlet	6/6	8/6	8/6	8/6	8/6
Condensate Outlet/Hot Water Outlet	2/6	3/6	3/6	3/6	3/6


*Standard shipping configuration is 1-piece for sizes 010-047; 2-pieces for sizes 054-068.

16JB SIZES 010-068

TYPICAL SIDE VIEW

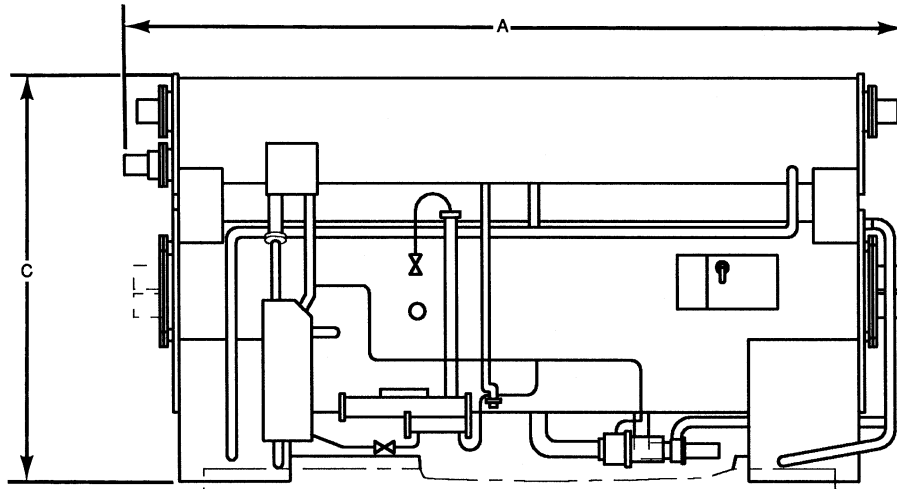

TYPICAL END VIEW

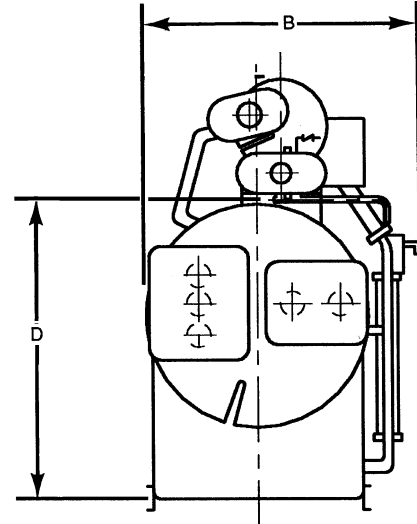

DIMENSIONS (ft-in.)

UNIT 16JB	010	012	014	018	021	024	028	032	036	041	047	054	057	061	068
Overall Length A	16- 9	16- 9	16- 9	16- 9	16- 9	16-11	16-11	16-10	16-10	16-10	16-10	21- 8	21- 8	21-8	21-8
Overall Width B	3- 8	3- 8	3- 8	4- 5	4- 5	5- 1	5- 1	6- 4	6- 4	7- 5	7- 5	6- 4	6- 4	7-4	7-4
Overall Height C	7- 4	7- 4	7- 4	7-10	7-10	8-10	8-10	10- 2	10- 2	11- 6	11- 6	11-10	11-10	13-2	13-2
Height D*	4-10	4-10	4-10	5- 7	5- 7	6- 3	6- 3	7- 4	7- 4	8- 7	8- 7	8- 2	8- 2	9-7	9-7

DIMENSIONS (mm)

UNIT 16JB	010	012	014	018	021	024	028	032	036	041	047	054	057	061	068
Overall Length A	5105	5105	5105	5105	5105	5160	5160	5130	5130	5130	5130	6605	6605	6605	6605
Overall Width B	1120	1120	1120	1350	1350	1550	1550	1930	1930	2260	2260	1930	1930	2230	2230
Overall Height C	2230	2230	2230	2390	2390	2540	2540	3110	3110	3505	3505	3605	3605	4020	4020
Height D*	1473	1473	1473	1702	1702	1905	1905	2235	2235	2616	2616	2489	2489	2921	2921

*Standard shipping configuration is 1-piece for sizes 010-047; 2-pieces for sizes 054-068.
Dimension "D" is height of absorber/evaporator section for 2-piece shipment.

NOTES:

1. All dimensions are approximate and do not take into account absorber-condenser crossover piping.
2. For routine maintenance, allow 3 ft (1 m) clearance on all sides and 6 in. (150 mm) above chiller.
3. For service access, allow clearances as follows:
 - a. For tube removal, allow space equal to "A" dimension (length) at either end of the chiller.
 - b. To open waterbox cover, allow clearance space equal to half of "B" dimension (width) on the waterbox end of the chiller.

Performance data



ENGLISH

UNIT 16JB	010	012	014	018	021	024	028	032
COOLING CAPACITY (ton)	108	122	137	186	211	245	279	326
CHILLED WATER								
Flow Rate (gpm)	259	292	328	446	506	587	669	781
Pressure Drop (ft)	15.9	16.0	16.4	15.6	15.7	15.9	16.2	15.6
COOLING WATER								
Flow Rate (gpm)	389	439	493	670	760	882	1004	1174
Pressure Drop (ft)	20.0	20.2	19.2	22.4	23.2	20.8	20.9	21.3
STEAM (lb/hr-ton)	1915	2178	2448	3319	3784	4373	5004	5826
(lb/hr)	17.7	17.9	17.9	17.8	17.9	17.9	17.9	17.9

UNIT 16JB	036	041	047	054	057	061	068
COOLING CAPACITY (ton)	362	413	479	539	574	618	680
CHILLED WATER							
Flow Rate (gpm)	868	990	1148	1292	1376	1481	1630
Pressure Drop (ft)	15.7	15.9	16.1	33.3	32.9	32.7	32.9
COOLING WATER							
Flow Rate (gpm)	1303	1487	1724	1940	2066	2225	2448
Pressure Drop (ft)	22.0	20.9	21.6	35.9	36.2	36.5	36.3
STEAM (lb/hr-ton)	6492	7387	8585	9706	10,440	11,231	12,456
(lb/hr)	17.9	17.9	17.9	18.0	18.2	18.2	18.3

LEGEND

ARI — Air Conditioning and Refrigeration Institute

NOTE: Ratings are based on ARI 560, latest edition, 54/44 F (2.4 gpm/ton) chilled water; 85 F cooling water (3.6 gpm/ton); fouling factor .00025 ft²-hr – F/Btu.

SI

UNIT 16JB	010	012	014	018	021	024	028	032
COOLING CAPACITY (kW)	380	429	482	654	742	862	981	1147
CHILLED WATER								
Flow Rate (L/s)	16.3	18.5	20.7	38.1	31.9	37.1	42.2	49.3
Pressure Drop (kPa)	47.6	47.9	49.0	46.7	46.9	47.6	48.3	46.7
COOLING WATER								
Flow Rate (L/s)	24.5	27.7	31.1	42.3	47.9	55.6	63.3	74.1
Pressure Drop (kPa)	59.8	60.5	57.3	67.0	69.4	62.2	62.4	63.7
STEAM (kg/hr-kW)	2.29	2.30	2.30	2.30	2.31	2.30	2.31	2.30
(kg/hr)	867	988	1110	1505	1716	1983	2269	2642

UNIT 16JB	036	041	047	054	057	061	068
COOLING CAPACITY (kW)	1273	1453	1685	1896	2019	2173	2392
CHILLED WATER							
Flow Rate (L/s)	54.7	62.5	72.4	81.5	86.8	93.5	102.8
Pressure Drop (kPa)	46.9	47.4	48.2	99.4	98.4	97.7	98.4
COOLING WATER							
Flow Rate (L/s)	82.2	93.8	108.8	122.4	130.3	140.4	154.4
Pressure Drop (kPa)	65.9	62.3	64.6	107.4	108.3	109.2	108.4
STEAM (kg/hr-kW)	2.31	2.31	2.31	2.32	2.35	2.34	2.36
(kg/hr)	2944	3350	3893	4402	4735	5093	5649

LEGEND

ARI — Air Conditioning and Refrigeration Institute

NOTE: Ratings are based on ARI 560, latest edition, 12.2/6.7 C (.043 L/s-kW) chilled water; 29.4 C (.081 L/s-kW) cooling water; fouling factor .000044 m²-hr – C/w.

Part-load performance

Through the use of Carrier's Electronic Catalog (E-CAT) computer program, part-load performance energy requirements ranging from 10% to 100% of full load can be provided in accurate detail. These programs are rated in accordance with ARI 560, latest edition.

Vent and drain connections

All vent and drain connections are found on the waterbox covers. Connection size is 3/4 in. FPT.

Provide high points of the machine piping system with vents and the low points with drains. If shutoff valves are provided in the main water pipes near the unit, a minimum amount of system water is lost when the heat exchangers are drained.

It is recommended that pressure gages be provided at points of entering and leaving water to measure pressure drop through the heat exchanger. Gages may be installed as shown in the table below. Pressure gages installed at the vent and drain connections do not include nozzle pressure losses.

Use a reliable manometer to measure pressure differential when determining water flow. Regular gages are insensitive and do not provide an accurate measurement of flow conditions.

NUMBER OF PASSES	GAGE LOCATION
1,3	One gage in each waterbox
2,4	Two gages in waterbox with nozzles

Range of application

The 16JB single effect absorption chiller is designed for standard water chilling applications of 108 to 680 tons (380 to 2,392 kW) at standard ARI rating conditions.

ASME stamping

The water side of the 16JB054 (and larger) absorbers and the 16JB061 (and larger) evaporators shall carry the ASME Section VIII "U" stamp. In addition, the water side of all 16JB hot water generators shall also be stamped.

Rupture disk piping

The 16JB hot water generator is equipped with a rupture disk. It is recommended that piping from the rupture disk be routed to appropriate areas away from the machine in accordance with Carrier's written installation instructions, the latest version of ANSI/ASHRAE-15 (American National Standards Institute/American Society of Heating, Refrigeration, and Air Conditioning Engineers), and any local jurisdictional requirements that may apply. Piping should be adequately supported and the proper fittings should be provided to allow periodic inspection of the disk. Refer to Carrier 16JB certified drawings for the exact location of the rupture disk on the chiller.

UNIT SIZE	RUPTURE DISK CONNECTION SIZE
16JB010-021	2 in. 150 psig (1034 kPa) RF flange
16JB024-036	3 in. 150 psig (1034 kPa) RF flange
16JB041-068	4 in. 150 psig (1034 kPa) RF flange

LEGEND

RF — Raised Face

Service access

To perform routine maintenance, allow 3 ft (1 m) clearance on all sides of machine and 6 in. (150 mm) above the chiller. Tube removal space equal to the overall length of the unit should be provided on either end of the 16JB.

MATERIAL SPECIFICATIONS

ITEM	MATERIAL	SPECIFICATION
SHELL:		
Evaporator	Steel	ASTM A285
Absorber	Steel	ASTM A285
Condenser	Steel	ASTM A285
Generator	Steel	ASTM A285
TUBESHEET:		
Evaporator	Steel	ASTM A285
Absorber	Steel	ASTM A285
Condenser	Steel	ASTM A285
Generator	Steel	ASTM A285
WATERBOX:		
Evaporator	Steel	ASTM A285
Absorber	Steel	ASTM A285
Condenser	Steel	ASTM A285
Generator	Steel	ASTM A285
TUBES:		
Evaporator	Copper	ASME SB359
Absorber	Copper	ASME SB75
Condenser	Copper	ASME SB75
Generator	90-10 CuNi	ASME SB111
		Alloy 706
PIPING:		
	Steel	ASTM A53

LEGEND

ASME — American Society of Mechanical Engineers
 ASTM — American Society for Testing and Materials



HEAT EXCHANGER STANDARD PASS AND NOZZLE ARRANGEMENTS

16JB010-068 EVAPORATOR								
1-Pass			2-Pass			3-Pass		
In	Out	Arrangement	In	Out	Arrangement	In	Out	Arrangement
L	R	T	L	L	X	R	L	V
R	L	S	R	R	W	L	R	U

ABSORBER

2-Pass								
Size 010-014			Size 024,028			Size 018,021, 032-068		
In	Out	Arrangement	In	Out	Arrangement	In	Out	Arrangement
L	L	Z	L	L	Z	L	L	Z
R	R	Y	R	R	Y	R	R	Y

LEGEND

- L — Left End Inlet
R — Right End Inlet

NOTE: Condenser is always 1-pass/inlet located on the same side as the absorber outlet. Generator inlet and outlet are always located on left end (when facing the control center).

HEAT EXCHANGER MINIMUM/MAXIMUM FLOW RATES

ENGLISH (gpm)

UNIT 16JB	EVAPORATOR								ABSORBER-CONDENSER	
	1-Pass		2-Pass		3-Pass		4-Pass		2-Pass/1-Pass	
	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max
010	212	850	106	425	71	283	53	212	149	581
012	240	962	120	481	80	320	60	240	174	646
014	270	1076	135	538	90	358	67	269	195	766
018	366	1460	183	730	122	486	91	365	259	957
021	414	1660	207	830	138	553	103	415	294	1078
024	482	1924	241	962	161	641	120	481	351	1277
028	548	2194	274	1097	182	731	137	548	404	1460
032	638	2554	319	1277	212	850	159	638	468	1724
036	710	2842	355	1421	236	946	177	710	511	1907
041	810	3242	405	1621	270	1080	202	810	585	2171
047	938	3754	469	1877	312	1250	234	938	681	2483
054	800	3204	400	1602	266	1067	200	800	592	2347
057	860	3444	430	1722	286	1147	215	860	638	2489
061	934	3738	467	1869	311	1245	233	934	692	2681
068	1030	4118	515	2059	343	1371	257	1028	766	3001

NOTE: Flow rates based on standard tubes. Minimum flow based on tube velocity of 3 ft/sec; maximum flow based on 12 ft/sec.

SI (L/s)

UNIT 16JB	EVAPORATOR								ABSORBER-CONDENSER	
	1-Pass		2-Pass		3-Pass		4-Pass		2-Pass/1-Pass	
	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max
010	13	54	7	27	4	18	3	13	9	37
012	15	61	8	30	5	20	4	15	11	41
014	17	68	9	34	6	23	4	17	12	48
018	23	92	12	46	8	31	6	23	16	61
021	26	105	13	52	9	35	7	26	19	68
024	30	122	15	61	10	41	8	30	22	81
028	35	139	17	69	12	46	9	35	26	92
032	40	162	20	81	13	54	10	40	30	109
036	45	180	22	90	15	60	11	45	32	121
041	51	205	26	103	17	68	13	51	37	137
047	59	237	30	119	20	79	15	59	43	157
054	51	203	25	101	17	67	13	51	37	148
057	54	218	27	109	18	73	14	54	40	157
061	59	236	30	118	20	79	15	59	44	170
068	65	260	33	130	22	87	16	65	48	190

NOTE: Flow rates based on standard tubes. Minimum flow based on tube velocity of .9 m/sec; maximum flow based on 3.6 m/sec.

Electrical data (60 Hz)



UNIT VOLTAGE 208/230-3-60*

UNIT 16JB	PUMP/MOTOR SIZE (Hp)		RLA		LRA		MCA	MFA	kW
	SP	RP	SP	RP	SP	RP			
010	3	3	12.0	12.0	55.0	55.0	28.0	40.0	3.8
012	3	3	12.0	12.0	55.0	55.0	28.0	40.0	3.8
014	3	3	12.0	12.0	55.0	55.0	28.0	40.0	3.8
018	3	3	12.0	12.0	55.0	55.0	28.0	40.0	4.1
021	3	3	12.0	12.0	55.0	55.0	28.0	40.0	4.1
024	3	3	12.0	12.0	55.0	55.0	28.0	40.0	4.4
028	3	3	12.0	12.0	55.0	55.0	28.0	40.0	4.4
032	5	3	19.0	12.0	82.0	55.0	36.8	50.0	5.0
036	5	3	19.0	12.0	82.0	55.0	36.8	50.0	5.0
041	5	5	19.0	19.0	82.0	82.0	43.8	60.0	5.9
047	5	5	19.0	19.0	82.0	82.0	43.8	60.0	5.9
054	5	5	19.0	19.0	82.0	82.0	43.8	60.0	6.8
057	5	5	19.0	19.0	82.0	82.0	43.8	60.0	6.8
061	5	5	19.0	19.0	82.0	82.0	43.8	60.0	7.3
068	5	5	19.0	19.0	82.0	82.0	43.8	60.0	7.3

460-3-60*

UNIT 16JB	PUMP/MOTOR SIZE (Hp)		RLA		LRA		MCA	MFA	kW
	SP	RP	SP	RP	SP	RP			
010	3	3	6.0	6.0	27.5	27.5	14.5	20.0	3.8
012	3	3	6.0	6.0	27.5	27.5	14.5	20.0	3.8
014	3	3	6.0	6.0	27.5	27.5	14.5	20.0	3.8
018	3	3	6.0	6.0	27.5	27.5	14.5	20.0	4.1
021	3	3	6.0	6.0	27.5	27.5	14.5	20.0	4.1
024	3	3	6.0	6.0	27.5	27.5	14.5	20.0	4.4
028	3	3	6.0	6.0	27.5	27.5	14.5	20.0	4.4
032	5	3	9.5	6.0	41.0	27.5	18.9	25.0	5.0
036	5	3	9.5	6.0	41.0	27.5	18.9	25.0	5.0
041	5	5	9.5	9.5	41.0	41.0	22.4	30.0	5.9
047	5	5	9.5	9.5	41.0	41.0	22.4	30.0	5.9
054	5	5	9.5	9.5	41.0	41.0	22.4	30.0	6.8
057	5	5	9.5	9.5	41.0	41.0	22.4	30.0	6.8
061	5	5	9.5	9.5	41.0	41.0	22.4	30.0	7.3
068	5	5	9.5	9.5	41.0	41.0	22.4	30.0	7.3

575-3-60

UNIT 16JB	PUMP/MOTOR SIZE (Hp)		RLA		LRA		MCA	MFA	kW
	SP	RP	SP	RP	SP	RP			
010	3	3	4.8	4.8	23.0	23.0	11.8	15.0	3.8
012	3	3	4.8	4.8	23.0	23.0	11.8	15.0	3.8
014	3	3	4.8	4.8	23.0	23.0	11.8	15.0	3.8
018	3	3	4.8	4.8	23.0	23.0	11.8	15.0	4.1
021	3	3	4.8	4.8	23.0	23.0	11.8	15.0	4.1
024	3	3	4.8	4.8	23.0	23.0	11.8	15.0	4.4
028	3	3	4.8	4.8	23.0	23.0	11.8	15.0	4.4
032	5	3	7.6	4.8	33.0	23.0	15.3	20.0	5.0
036	5	3	7.6	4.8	33.0	23.0	15.3	20.0	5.0
041	5	5	7.6	7.6	33.0	33.0	18.1	25.0	5.9
047	5	5	7.6	7.6	33.0	33.0	18.1	25.0	5.9
054	5	5	7.6	7.6	33.0	33.0	18.1	25.0	6.8
057	5	5	7.6	7.6	33.0	33.0	18.1	25.0	6.8
061	5	5	7.6	7.6	33.0	33.0	18.1	25.0	7.3
068	5	5	7.6	7.6	33.0	33.0	18.1	25.0	7.3

*Refrigerant and solution pump/motor assemblies are designed for dual voltage applications and can be applied at either 208/230-3-60 or 460-3-60 (requiring only wiring and heater element changes).

LEGEND

- LRA — Locked Rotor Amps
- MCA — Minimum Circuit Ampacity
- MFA — Maximum Fuse Amps
- RLA — Rated Load Amps
- RP — Refrigerant Pump
- SP — Solution Pump

NOTES:

1. Standard voltages (3-Ph, 60 Hz)

VOLTAGE	FOR USE ON SUPPLY VOLTAGES
208	200 to 208 Volt Systems
230	220 to 240 Volt Systems
460	440 to 480 Volt systems
575	550 to 600 Volt Systems

Motor nameplates can be stamped for any voltage within the supply voltage range.

2. Control circuit voltage 110-1-60.
3. Control circuit amps = 1.0.
4. MCA and MFA include refrigerant and solution pumps, and control circuit.
5. kW includes solution and refrigerant pumps and control circuit.

Electrical data (50 Hz)



UNIT VOLTAGE

400-3-50

UNIT 16JB	PUMP/MOTOR SIZE (Hp)		RLA		LRA		MCA	MFA	kW
	SP	RP	SP	RP	SP	RP			
010	3	5	6.0	10.5	27.5	41.0	10.0	30.0	3.8
012	3	5	6.0	10.5	27.5	41.0	10.0	30.0	3.8
014	3	5	6.0	10.5	27.5	41.0	10.0	30.0	3.8
018	3	5	6.0	10.5	27.5	41.0	10.0	30.0	4.1
021	3	5	6.0	10.5	27.5	41.0	10.0	30.0	4.1
024	5	5	10.5	10.5	41.0	41.0	20.0	30.0	4.4
028	5	5	10.5	10.5	41.0	41.0	20.0	30.0	4.4
032	5	5	10.5	10.5	41.0	41.0	20.0	30.0	5.0
036	5	5	10.5	10.5	41.0	41.0	20.0	30.0	5.0
041	5	5	10.5	10.5	41.0	41.0	20.0	30.0	5.9
047	5	5	10.5	10.5	41.0	41.0	20.0	30.0	5.9
054	5	5	10.5	10.5	41.0	41.0	20.0	30.0	6.8
057	5	5	10.5	10.5	41.0	41.0	20.0	30.0	6.8
061	5	5	10.5	10.5	41.0	41.0	20.0	30.0	7.3
068	5	5	10.5	10.5	41.0	41.0	20.0	30.0	7.3

LEGEND

- LRA** — Locked Rotor Amps
- MCA** — Minimum Circuit Ampacity
- MFA** — Maximum Fuse Amps
- RLA** — Rated Load Amps
- RP** — Refrigerant Pump
- SP** — Solution Pump

NOTES:


1. Standard voltages (3-Ph, 50 Hz)

VOLTAGE	FOR USE ON SUPPLY VOLTAGES
400	380 to 415 Volt Systems

Motor nameplates can be stamped for any voltage within the supply voltage range.

2. Control circuit voltage 110-1-50.
3. Control circuit amps = 1.0.
4. MCA and MFA include refrigerant and solution pumps, and control circuit.
5. kW includes solution and refrigerant pumps and control circuit.

Typical piping and wiring

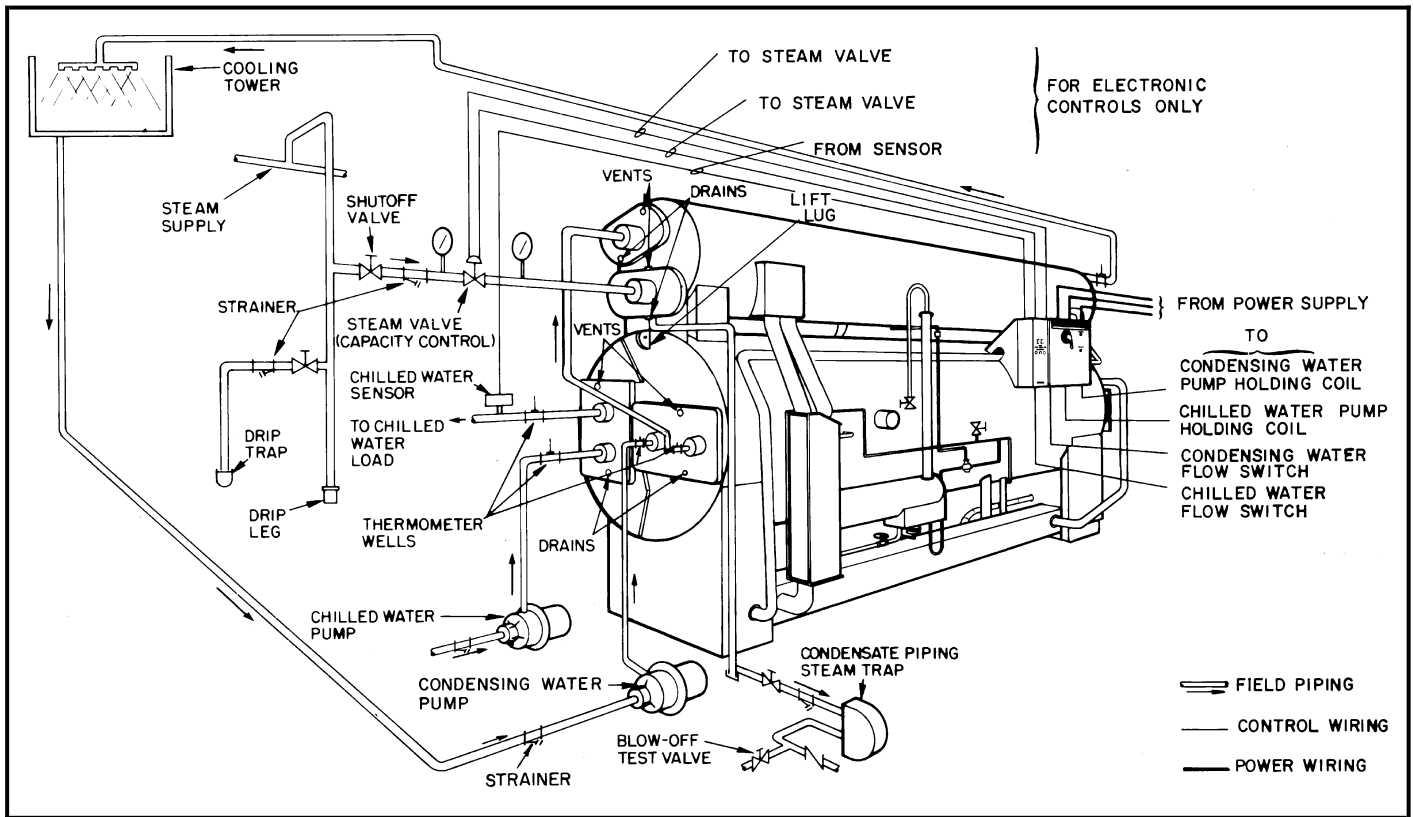

Hermetic Absorption Liquid Chiller

Size Range: **108 to 680 Tons (380 to 2392 kW)**

Carrier Model Number: **16JB**

Part 1 — General

1.01 SYSTEM DESCRIPTION

Electronically controlled, single effect (one-stage) absorption liquid chiller utilizing hermetic refrigerant and solution pumps, lithium bromide solution as the absorbent, and water as the refrigerant. Low pressure steam or hot water shall be supplied to the generator as the heat source.

1.02 QUALITY ASSURANCE

- A. Chiller performance shall be rated in accordance with ARI Standard 560 (latest edition).
- B. Chiller shall be manufactured in accordance with ANSI/ASHRAE 15 (latest edition) Safety Code for Mechanical Refrigeration.
- C. The tubeside of the absorber and evaporator sections (when applicable) and the tubeside of the generator (for hot water applications) shall be designed, constructed, and stamped in accordance with ASME Section VIII, Division 1 requirements.
- D. Each chiller shall undergo a series of standard factory tests to ensure that the unit is leak tight, that all electrical components operate as intended, and that every aspect of unit fabrication meets stringent quality standards in accordance with good practice and the manufacturer's quality assurance requirements.

1. The shellside of each chiller shall be leak tested by pressurizing to 15 psig (103 kPa) with dry air and then checked by spraying a soap/water mixture on all welds, tube joints, and/or gasketed joints to identify any major leaks. Afterward, a mass spectrometer test shall be performed by evacuating the unit to 0.10 mm Hg absolute, covering the machine with a vinyl tent and introducing helium gas under the tent. Any remaining leaks will allow the helium to be drawn into the shellside of the machine. The acceptable total leak rate as measured by the mass spectrometer test shall not exceed .00002 cc/sec standard air.
2. The tubeside of the evaporator, absorber, condenser, and (steam) generator shall be hydrostatically tested at 1.5 times rated design pressure and held for 1 hour. For hot water applications, a pneumatic test shall be performed on the generator at 1.25 times rated design pressure.
3. All machine wiring shall undergo an insulation resistance test. The machine control center and all electrical components shall also be functionally tested to verify continuity and proper electrical operation.
4. Final assembly inspection shall consist of verifying that all valves, controls, instrumentation, pumps, purge components, and all other machine components have been properly installed on the machine.

5. Each unit shall then be checked for overall appearance and dimensional accuracy.
6. Final inspection shall be performed on each unit to check that painting of the unit is as specified, nameplate data is correct, and that all accessories are furnished as required.

1.03 DELIVERY, STORAGE, AND HANDLING

- A. Unit shall be stored and handled in accordance with the manufacturer's recommendations.
- B. Unit shall *not* be factory-charged with lithium bromide solution to prevent possible internal corrosion damage from occurring should the inside of the machine be accidentally exposed to air during shipment and/or installation. Charging of lithium bromide solution shall be performed at the jobsite in accordance with the manufacturer's written instructions.
- C. One-piece units shall be shipped under vacuum on the shellside. Two-piece units shall be shipped with 5 psig (34 kPa) nitrogen pressure.
- D. Chiller shall be shipped with nameplates indicating name of manufacturer, model size, serial number, and all other pertinent machine data.
- E. Chiller shall include shipping rails as standard for ease of sliding or moving a unit into position to simplify installation. Neoprene isolation pads shall also be included with the machine as standard.

1.04 WARRANTY

Manufacturer shall guarantee the chiller against defects in materials or workmanship for a period of one year from date of initial operation or 18 months from date of shipment, whichever occurs first. Manufacturer shall provide the labor to repair or replace any part found to be defective in material or workmanship within the warranty period.

Part 2 — Products

2.01 EQUIPMENT

A. General:

Absorption liquid chiller shall include evaporator, absorber, condenser, generator, solution heat exchanger, refrigerant/solution pumps, purge system, piping, wiring, controls, and auxiliaries. Shipment of the machine shall be in 1 or 2 piece(s), depending on model size. Initial charge of lithium bromide shall be included with the chiller for charging at the jobsite. Generator shall be designed for operation on either low pressure steam or hot water as specified on the equipment schedule. A U-baffle shall be provided in both the upper and lower shell to serve as a natural insulating barrier between sections. The double sump formed by the U-baffle in the bottom of the absorber-evaporator section shall allow temporary storage of refrigerant or solution, thereby reducing service time and expense by alleviating the need to remove the fluids from the machine during service and/or maintenance operations.

B. Operating Characteristics:

1. Chiller operation shall be characteristic of a single effect absorption cycle. The weak solution pumped from the absorber to the generator shall initially pass through a solution heat exchanger to improve operating efficiency by preheating the weak solution on the tube side with the strong solution returning from the generator on the shellside.
2. Unit shall be capable of continuous operation from 100% to 10% capacity, with entering condenser water temperatures as low as 55 F (13 C) without the need for a cooling tower bypass valve. Thermostat on/off control of the cooling tower fan is recommended when cooling water temperature falls below 55 F (13 C).

C. Heat Exchangers:

1. All heat exchangers shall be of shell and tube construction with shells, tubesheets, tube support sheets, and waterboxes fabricated of carbon steel. All heat exchangers shall incorporate straight tubes, except for the generator which shall use U-tubes. All tubes shall be rolled into grooved tubesheets and expanded into tube support sheets. All tubes shall be individually replaceable.
2. The evaporator, absorber, and condenser waterboxes shall be designed for 150 psig (1034 kPa) working pressure and shall be supplied with nozzle-in-head (NIH), type C waterboxes. Removable waterbox covers shall permit access to all tubes from either end. All waterboxes shall be provided with vent and drain connections. Nozzle connections shall be of the weld-end type unless otherwise noted.
3. The generator tube bundle shall consist of U-bend tubes secured to the tube sheet on one end only to allow for thermal expansion and contraction. The tubeside of the generator shall be designed for 15 psig (103 kPa) working pressure for steam applications or 250 psig (1725 kPa) working pressure for hot water applications. All hot water generators shall be designed, constructed, and stamped in accordance with ASME Section VIII, Division 1 requirements on the tubeside. For steam applications, a vacuum breaker shall be factory supplied on the machine.
4. A solution heat exchanger shall be an integral part of the machine to increase efficiency by pre-heating weak solution on the tubeside with strong solution on the shellside. Tube material for this heat exchanger shall be carbon steel.
5. Spray heads for the evaporator, absorber, and generator shall be of a non-clogging design, specifically designed for the intended duty. Spray heads shall be fabricated of a corrosion-proof material to ensure continuous, high efficiency operation.
6. Heat exchanger tube material and minimum wall thickness shall be contingent on the type of corrosion inhibitor used in the machine. The

following tube specifications shall apply to ensure long machine life and continuous operation:

Evaporator	copper,externally finned
Absorber	copper, prime surface
Condenser	copper, prime surface
Generator	90/10 CuNi, prime surface

D. Pump/Motors:

Refrigerant and solution pump/motors shall be self-contained, leakproof, hermetic type, without pump seals, isolation valves, or external seal water system to minimize air leakage into the machine. Each pump casing shall be welded into suction and discharge lines and factory installed and shall include spring-loaded, wear-compensating, tapered carbon bearings. Lubrication and cooling shall be accomplished by the fluid being pumped; auxiliary water piping for cooling and lubrication shall not be acceptable. Pump/motor assemblies shall be designed for 50,000-60,000 hours of normal operation between inspections. If pump/motor assemblies are furnished with less than a design of 50,000-60,000 hours of normal operation between inspections, they must be provided with isolation valves and a bearing monitoring system to aid in diagnosing and performing on-going maintenance.

E. Purge System:

An automatic motorless purge system shall be furnished to provide a continuous purging action whenever the chiller is in operation to assure long machine life and efficient performance. Noncondensables shall be removed from the absorber by a liquid eductor, which shall use flow from the solution pump to create a suction. Noncondensables shall be stored external to the unit and shall be prevented from diffusing back into the machine when the unit is not operating. Evacuation of the external storage chamber shall be accomplished by manually positioning valves to pressurize the chamber with lithium bromide solution and exhausting it to atmosphere. If the purge system design is such that it *requires* a vacuum pump, then it shall be unit mounted and wired to the control center by the chiller manufacturer.

F. Controls:

1. Each chiller shall include a factory mounted and wired control center with lockable door. Machine operation shall be continuously controlled and monitored with the chiller operational status displayed on the front of the panel. Panel components shall include an electronic (or pneumatic) capacity control module, fused disconnect switch, pump contactors, ambient-compensated 3-phase pump overloads, multi-tap control power transformer, elapsed time indicator, terminal blocks, relays, auto/manual capacity control switch, auto/manual concentration control switch, refrigerant and solution pump operational switch, exhaust purge light, and all other necessary safeties and controls for proper machine operation.

2. Capacity control shall be either electronic or pneumatic as specified on the equipment schedule by regulating the flow of steam or hot water to the generator in response to the leaving chilled water temperature. The output from the capacity control module shall control the opening or closing of the capacity control valve. The steam control valve shall be factory supplied and field installed. Hot water valve shall be field supplied and field installed.
3. Provisions for interlocking control of the chilled water pump, condenser water pump, and cooling tower fans shall be included in the panel as standard.
4. Unit shall include an automatic concentration control system to prevent overconcentration and overdilution of the lithium bromide solution at all operating conditions. Operation shall be based on monitoring concentration (via refrigerant level in the evaporator) and temperature of the solution, and transferring water from the evaporator to the absorber to limit concentration when conditions warrant. Overdilution shall also be controlled via a low level switch in the evaporator.
5. Automatic dilution cycle shall lower the concentration of the lithium bromide solution to prevent possible crystallization in the heat exchanger. Control shall be turned off when refrigerant level falls to a preset level in the evaporator. Control shall be activated by chiller shutdown.

G. Machine Safety Devices:

1. Machine safety and limit devices shall be included as follows:
 - a. High refrigerant level — evaporator (limit)
 - b. Low refrigerant level — evaporator (limit)
 - c. Low refrigerant temperature
 - d. High motor winding temperature — refrigerant/solution pump
 - e. High motor amperage — refrigerant/solution pump
 - f. Low chilled water flow
 - g. Low cooling water flow
2. Chiller shall include a rupture disk when the generator is designed for hot water applications to protect against accidental overpressure.

H. Electrical Requirements:

1. Power supply to the unit shall be 3-ph, 60 Hz with voltages of 208, 230, 460, or 575 as specified on the equipment schedule. A multitap transformer shall provide 110 v single-phase secondary power for the control center.
2. Contractor shall supply and install the electrical power line and all auxiliary electrical protection devices per local code requirements and as indicated necessary by the chiller manufacturer.
3. Contractor shall supply and install electrical wiring and devices required to interface the chiller controls with the building control system, if applicable.

I. Piping Requirements:

1. Piping and instrumentation for the chilled water, cooling water, steam and condensate piping (or hot water supply and return piping) shall be supplied and installed by the contractor/owner.
2. Absorber-condenser crossover piping shall be furnished by the contractor/owner or the chiller manufacturer as specified on the equipment schedule.
3. Chilled water and condenser water flow switch shall be field installed and supplied by either the chiller manufacturer or the contractor/owner.
4. Piping from the rupture disk shall be provided and installed by the contractor/owner and piped in accordance with the chiller manufacturer's written instructions and any local jurisdictional requirements.

J. Thermal Insulation:

Evaporator surfaces shall be factory insulated. Insulation of refrigerant pump, sump, piping and chilled water headers, in addition to any hot surfaces shall be field supplied and installed on the machine. Chiller manufacturer shall recommend material and specify the surface area to be insulated.

K. Sound Level:

The overall sound pressure level of the chiller shall not exceed 80 dbA when measured per ARI Standard 575 (latest edition).

L. Start-Up:

1. Unit manufacturer shall provide a factory-trained service representative, employed by the chiller manufacturer, to perform and/or supervise chiller pressure test (when required), charge chiller with refrigerant (water) and lithium bromide solution, place unit into operation, and calibrate all controls in accordance with the manufacturer's written start-up, operating, and maintenance instructions.
2. After unit start-up has been performed, the same factory representative shall be available for a period of instruction not to exceed 4 hours to instruct the owner's personnel in the proper start-up, operating, and maintenance procedures.
3. Manufacturer shall provide the following literature:
 - a. Installation Instructions
 - b. Start-up, Operating and Maintenance Instructions
 - c. Field Wiring Diagrams

M. Options and Accessories:

1. Marine Waterboxes:

Marine waterboxes rated for 150 psig (1034 kPa) working pressure or 250 psig (1724 kPa) working pressure, with removable covers to facilitate tube cleaning and maintenance shall be furnished when specified on the equipment schedule.

2. High-Pressure Waterboxes:

Waterboxes rated for 250 psig (1724 kPa) working pressure with removable covers shall be furnished when specified on the equipment schedule.

3. Hot Water Generator:
A generator designed, built, and stamped in accordance with ASME Section VIII, Division 1 requirements with a design working pressure of 250 psig (1725 kPa) shall be furnished for hot water applications when specified on the equipment schedule.
4. Special Tubing:
Tubing of non-standard materials and/or wall thickness shall be provided when specified on the equipment schedule.
5. Absorber-Condenser Crossover Piping:
Crossover piping connecting the absorber to the condenser shall be furnished when specified on the equipment schedule.
6. CSA Certification:
Chiller shall be certified in accordance with CSA requirements when specified on the equipment schedule.
7. Shipping Configuration:
Chiller shall ship in either one or 2 piece(s) as specified on the equipment schedule.
8. Steam Demand Limiter:
The chiller control center shall include a start-up steam demand limiter (either electric or pneumatic) as specified on the equipment schedule.
9. Part-Load Economizer:
A part-load economizer valve, designed to improve operating efficiency by reducing the flow of solution to the generator when unit capacity falls below 50%, shall be provided when specified on the equipment schedule.
10. Flanged Nozzle Connections:
ANSI 150 psig (1034 kPa) RF (raised face) flanges shall be furnished on all waterbox nozzle connections when specified on the equipment schedule.
11. Victaulic Nozzle Connections:
Victaulic grooves shall be provided on all waterbox nozzle connections when specified on the equipment schedule.
12. Thermometer Set:
A package of 5 adjustable angle thermometers shall be factory supplied for field installation when specified on the equipment schedule. Each shall have a 9-in. scale with a working range of 0 F to 120 F (-17.7 C to 48.8 C) and shall be equipped with a 3/4-in. NPT brass well.
13. Chilled and Condenser Water Flow Switches:
Chilled water and condenser water flow switches, rated for either for 150 psig (1034 kPa) or 250 psig (1724 kPa), shall be factory supplied for field installation when specified on the equipment schedule.
14. Steam Valve (Electronic or Pneumatic):
A steam valve shall be provided when specified on the equipment schedule.
15. Unit Voltage:
Unit shall be capable of operating on 3 phase, 50/60 Hz, when specified on the chiller schedule.
16. Isolation Package:
A vibration isolation package consisting of machine soleplates and neoprene isolation pads shall be furnished when specified on the equipment schedule.

