

YORK
INTERNATIONAL

BS5750 PART 1



CERT NO. FM 970
QAS NO. 5284/98

FORM; L160.43/58 RP 2
PAGE No. 1 of 4
EFFECTIVE DATE; 30th MAY 1977

FILE: SERVICE/PARTS MANUAL

RENEWAL PARTS

SUPERSEDES FORM; L160.43 RP(175) Sect. 4
PAGE No. ALL
DATED; 1st JAN 1975

MAILING CODE; LS/R

OT/HT TURBOPAK TURBOGUARD PURGE UNIT

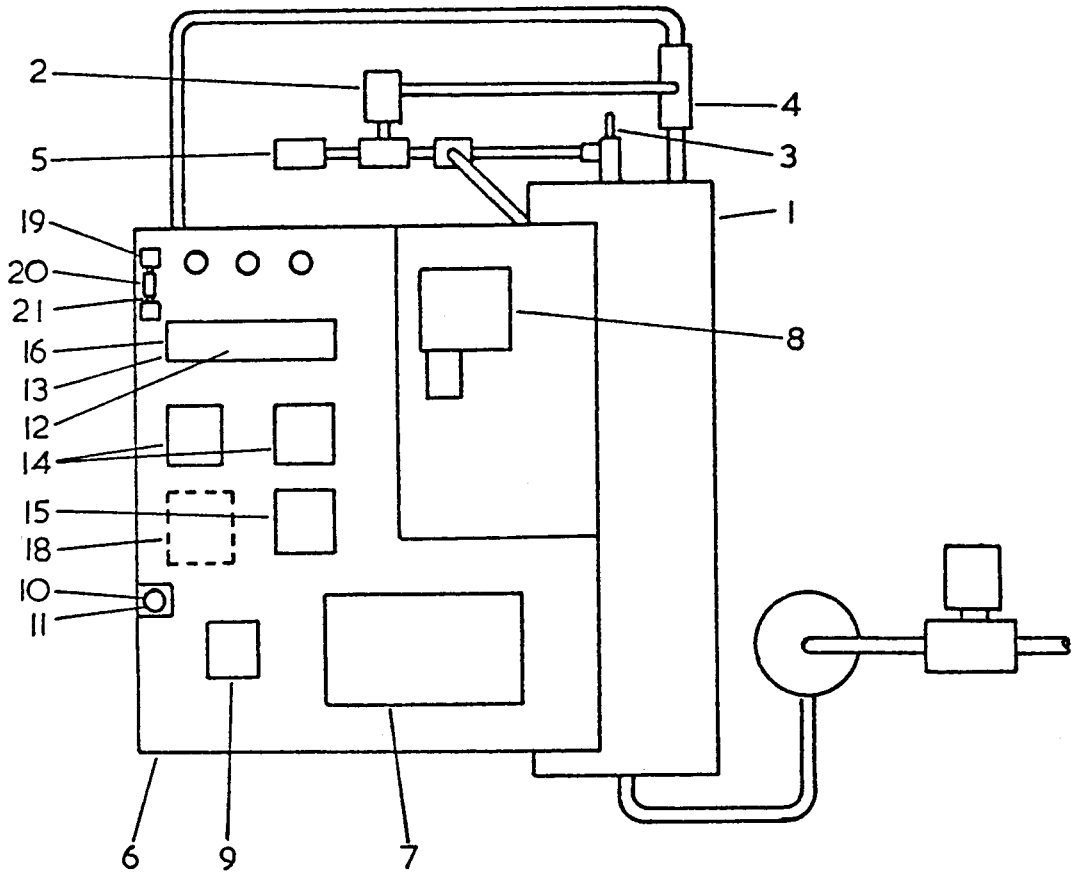


TABLE 1 — TURBOGUARD PURGE UNIT COMPONENTS 220-240V

ITEM NO.	DESCRIPTION	PART NUMBER	QUANTITY PER UNIT
1	Float switch	024L00245B000	1
2	Solenoid valve	025-16870 000	1
3	Shut off valve	023L00460 000	1
4	Conduit box	025L00061 000	1
5	Check valve	022-03571 000	1
6	Sheet metal box with door and lock	366L00727C000	1
7	Purge cycle counter (ICC)	025L00275C000	1
8	Pressure control (PHP)	025-17676 000	1
9	Timer (12 TR) 240 mm	025L00276C000	1
10	Fuse, 0.5 Amps (5FU)	025-14383 000	1
11	Fuse holder	025L00529 000	1
12	Terminal block	025-15865 000	10
13	Terminal End block	025-13981 000	1
14	Control relay (22R, 25R)	024L00004 000	2
15	Control relay (24R)	024L00006 000	1
16	Strip marker	025-17703A000	1
17	Lock and key (not shown)	025L00005 000	1
18	Earth terminal mtg. post	025L00538 000	2
19	Earth terminal AK-4	025L00539 000	5
20	Earth bus bar copper	025L00537 000	0.375 Ft
	Aux. Control Panel 220-240V complete	366L00726C000	1
	Turboguard purge unit 220-240V complete	366L00787D000	1

TABLE 2 — TURBOGUARD PURGE UNIT COMPONENTS 115V (For use with 220–240V Control Centre)

ITEM NO.	DESCRIPTION	PART NUMBER	QUANTITY PER UNIT
1	Float switch	024-16306B000	1
2	Solenoid valve	025-16479 000	1
3	Shut off valve	023L00460 000	1
4	Conduit box	025L00061 000	1
5	Check valve	022-03571 000	1
7	Purge cycle counter (ICC)	025-17687C000	1
8	Pressure control (PHP)	025-17676 000	1
9	Timer (12 TR)	325-17682C001	1
10	Fuse 0.5 Amp (5FU)	025-14383 000	1
11	Fuse holder	025L00529 000	1
12	Terminal block	025-15865 000	11
13	Terminal end block	025-13981 000	1
14	Control relay (22R, 25R)	024-17075 000	2
15	Control relay (24R)	024-14519 000	1
16	Strip marker	025-17703A000	1
17	Lock and key (not shown)	025L00005 000	1
18	Transformer 220–240V/115V	025L00103 000	1
19	Earth terminal mtg. post	025L00538 000	1
20	Earth terminal AK-4	025L00537 000	5
21	Earth bus bar copper	025L00537 000	0.375 Ft
	Aux. Control Panel 115V complete	366L00321D000	1
	Turboguard purge unit 115V complete	366L00057D000	1

YORK

YORK International Limited, Gardiners Lane South, Basildon, Essex SS14 3HE, ENGLAND

U.K. Health & Safety at Work Act 1974

The Health & Safety at Work Act 1974 places on the Manufacturer of products for use at work the responsibility to ensure, so far as reasonably practicable, that those products are safe when properly used. There is also the responsibility to carry out tests on the products to ensure safety when in use and to make available information on such products to the users.

York International Limited have always manufactured products to a basic standard such that there should be no significant health or safety hazard when equipment is installed, commissioned and used for the purpose for which it was intended.

All relevant information on installation and commissioning is available, on request, to all users. Products generally meet European standards and codes of practice relating to design and mode of operation.

FORM L 160.43/58 RP 2